


FIREPLACE KIT SYSTEM FROM BRUNNER




BSK 04 Tunnel mit Stil-Tunnel 62/76

State: 25.01.2017

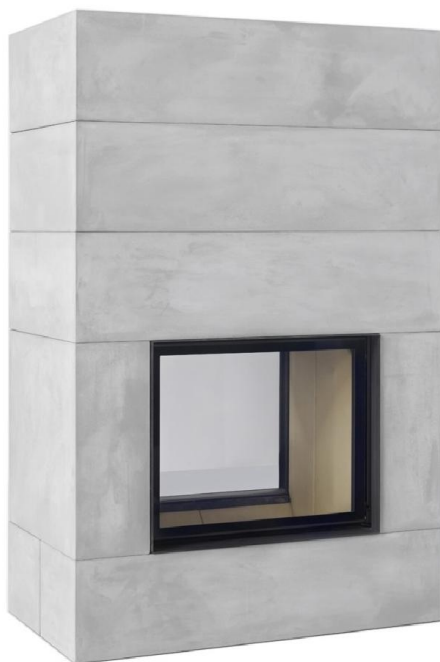

BRUNNER[®]
made in germany.

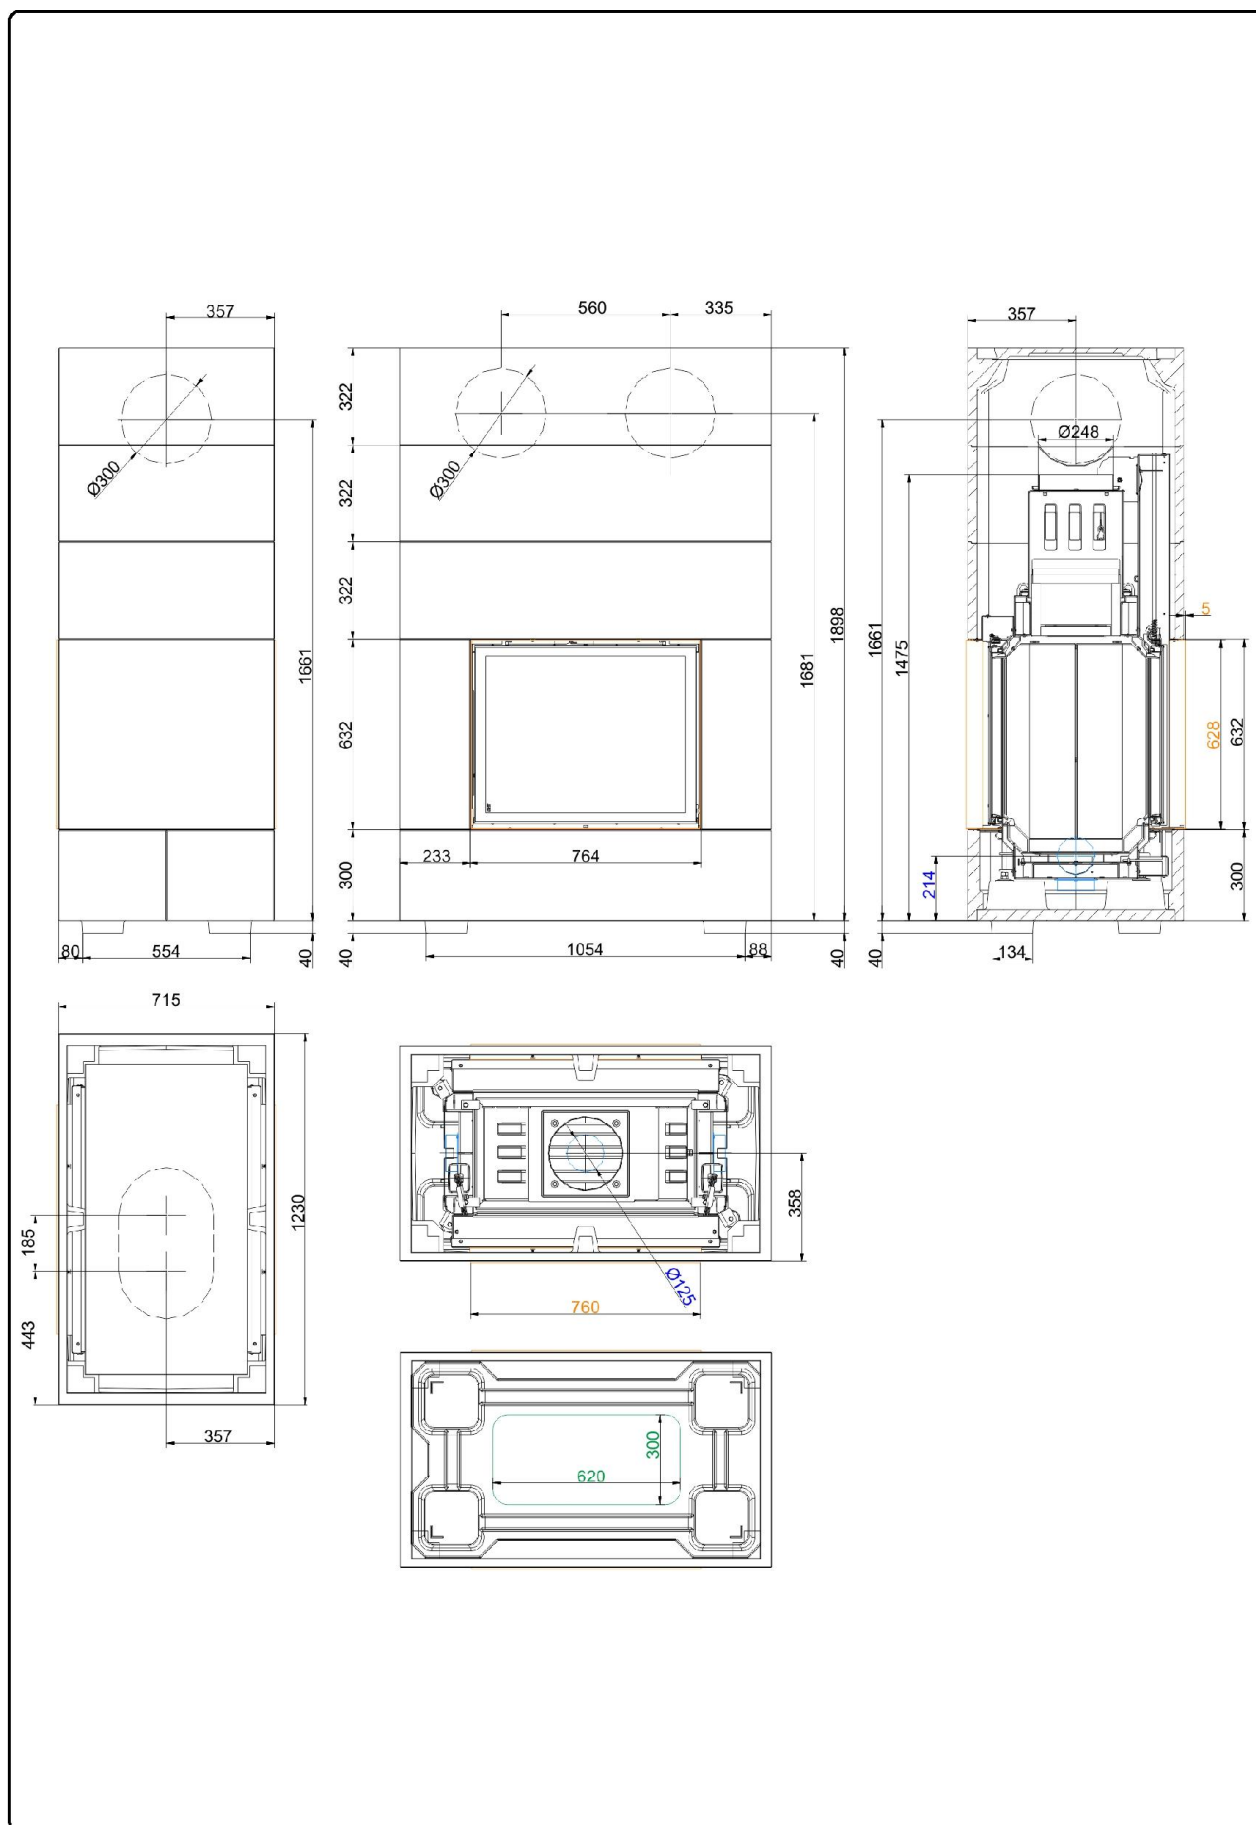

Planning and installation

BSK 04 Tunnel mit Stil-Tunnel 62/76

Tested according to

EN 13229

Data for functional demonstration

Rated heat output (heating insert)	kW	11
Firewood consumption	kg/h	3,2
Flue gas mass flow	g/s	10
Flue gas temperature	°C	180
Necessary supply pressure ¹⁾	Pa	13
Combustion air consumption	m³/h	35
Combustion air connection Ø	mm	125

Height extension rings

Footprint (width x depth)	mm	1230 x 715
Overall height	mm	1938
Height extension ring	mm	322

Minimum distances BSK / BSO

to adjacent wall	cm	5
to other wall with heat protection panels	cm	0
to protected wall	cm	10
to protected wall with heat protection panels	cm	5
to the ceiling	cm	50

Heat insulation

In ceiling region connection with/without air grate	cm	22 / 16
---	----	---------

Vent cross-sections ²⁾

Supply air	cm²	1540
Warm air	cm²	1200

Weight

Total weight	kg	781
--------------	----	-----

meets requirement limit values for:

Germany / Austria / Switzerland / Norway	1.BImSchV (Stufe 2) / 15a BVG (2015) / LRV / -
--	--

1) Throttle flap recommended

2) Existing supply air opening